

PLC

Rev: V1.0.1

B 5

400-666-2163 86 0755-86600500

(+86)0755-86600999


518067

www.megmeet.com

PLC	1
	3
1	5
1.1	5
1.2	5
1.3	6
2	7
2.1 U	7
2.2	8
2.3	10
3	12
3.1	12
3.2 PLC	13
3.2.1	13
3.2.2 PLC	14
3.3	15
3.4	16
3.5	17
3.6	18
3.7	19
3.8	20
3.9	21
3.10	22

1

1.1

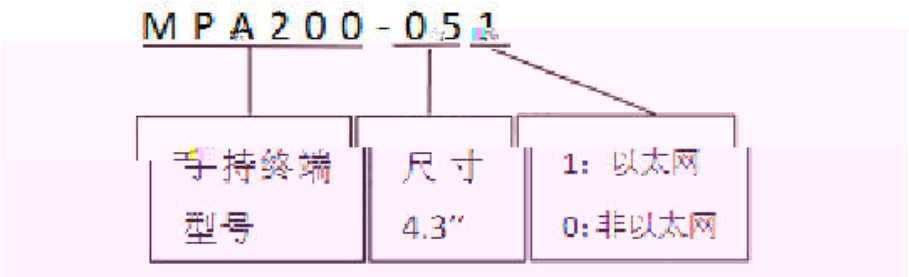

MPA200 PLC

05

4.3


1

PLC

0

PLC

1.2

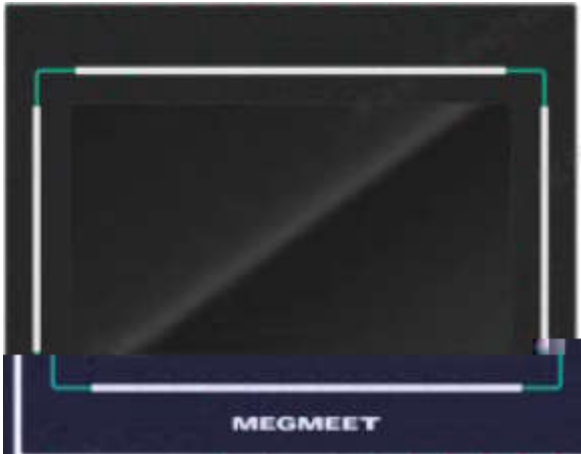

1.3



2

2.1 U


PLC

!!!

$$\vdots$$

- | | | | | |
|-----|-----------------------|---|---|------------|
| (1) | Environtment_Tool.zip | | | tpcbbackup |
| (2) | tpcbbackup | U | U | |


1- 3 :

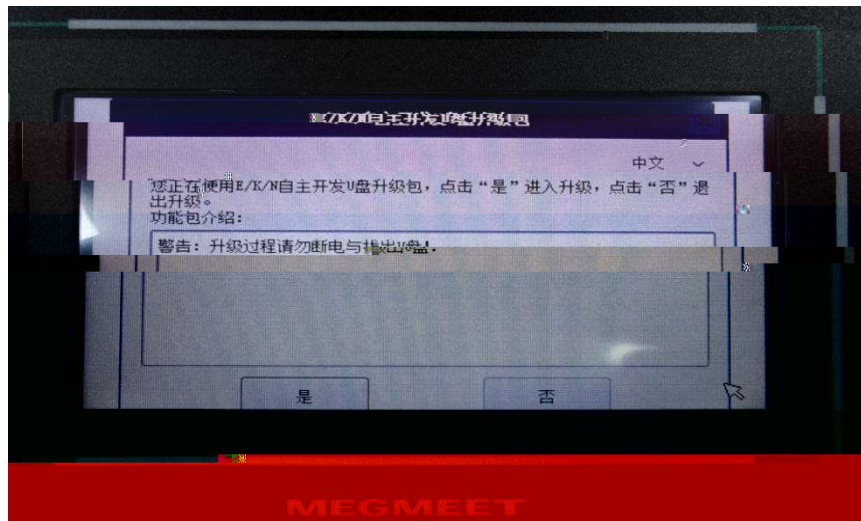

1 “ ”



2 “ ”

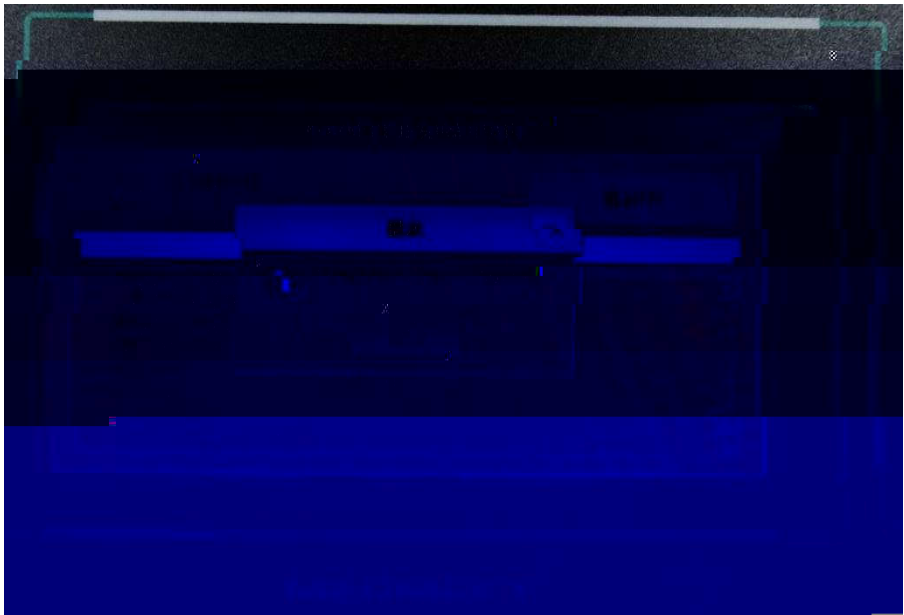

3

(3)

U

(4)

U

tpcbakup

tpcbakup

2.2

PLC

U

U

:

(1)

U

tpcbakup,

U

;

(2)

UDidsk_Tool.zip

tpcbakup;


(3)

tpcbakup


U

U

4- 5

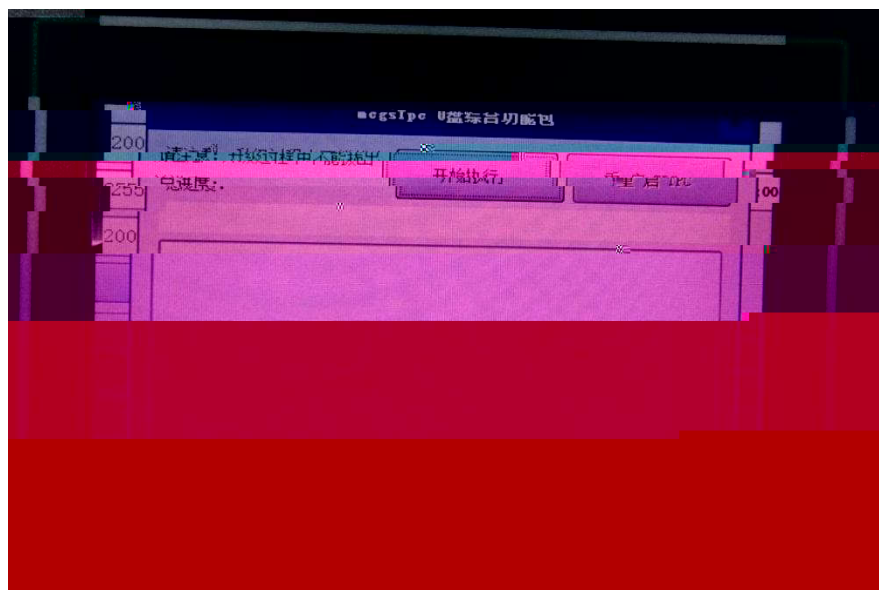

4 U ,

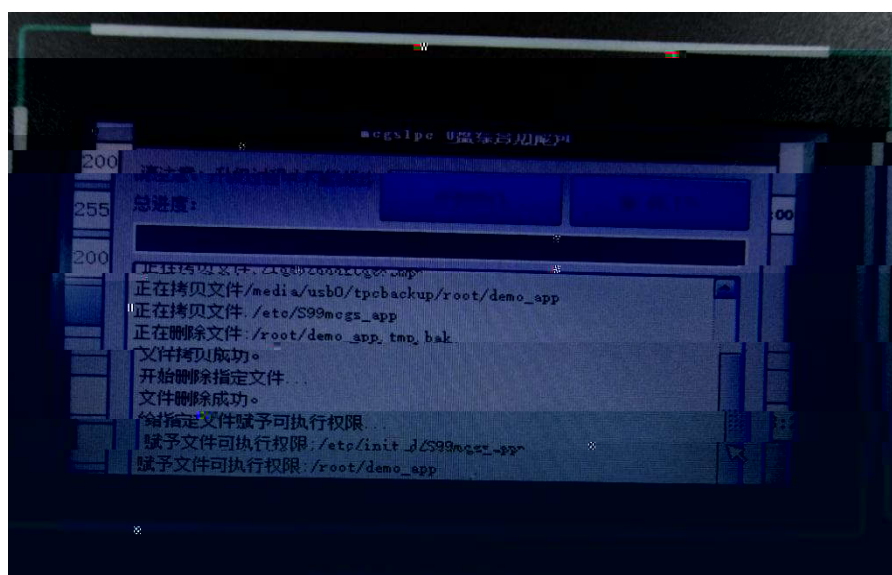

5

- (4) U ;
- (5) U tpcbakup tpcbakup
- U



8

(5)

,

3

3.1

8 : PLC



9

9 LOGO

3.2 PLC

PLC

PLC

PLC

3.2.1



10

PLC

PLC

PLC IP

PLC MAC

30

PLC

10HZ

2

2

6

:

PLC

PLC

”

”

:

PLC

3.2.2 PLC

PLC

PLC

PLC

PLC

MEGMEET

未联机

11:35:44

操作员

设备搜索

PLC信息

序号	名称	数据
1	CPU类型	
2	版本号	
3	当前扫描速率	
4	最小扫描速率	

读取PLC信息

退出

11 PLC

PLC

PLC

PLC

3.3

Megreator PLC

PLC

序号	程序名	剩余次数	修
1	MU100_TEST(MU100_4040BTA)	100	2025_1
2	MU320简单测试程序(MU320_2424BBA)	98	2025_1
3	测试程序(MC5001EB)	96	2025_1
4	MC5001EB_Expand(MC5001EB)	31	2025_1

选择程序:

下载

12

$$\vdots$$

1 0

Megreator

10 10

Megreator

Megreator

PLC

PLC

$$(\quad)$$

PLC

PLC

3.4

PLC

PLC

PLC

PLC



13

:

PLC

PLC

,

PLC

_

10

:

PLC

:

PLC

:

3.5

PLC

U

U

, PLC (.upgrade)


PLC

MEGMEET未联机14:49:00(8) 操作员

文件名	修改日期
 MEGreator_REP-20251126.zip	2025/11/26 18:58:02
 MU200_3232BTA_U111V1216....	2025/10/11 8:49:36
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17
 MU200_3232BTA_U111V1255....	2025/10/28 17:27:17

0%

3.6

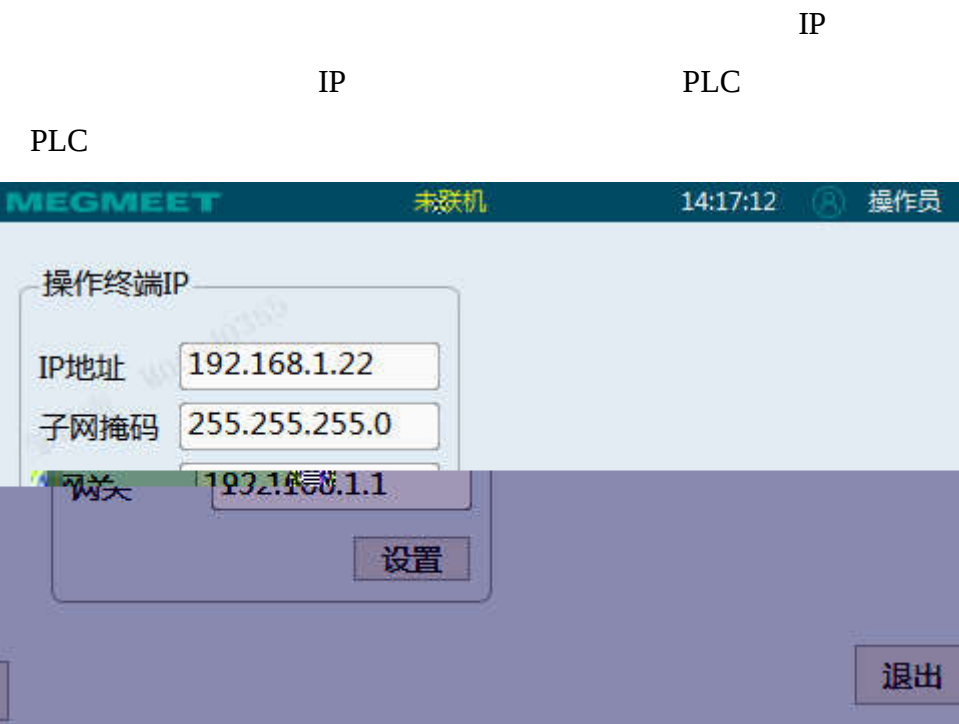

15

: Megreator PLC 1 IP 192.168.1.X

PLC IP

3.7

()



16

:
PLC PLC

3.8

MEGMEET

未联网

14:36:31

操作员

序号	运行记录	时间
1	启动操作终端!!!	2025-12-02 10:3...
2	退出操作终端!!!	2025-12-02 10:2...
3	启动操作终端!!!	2025-12-02 10:0...
4	退出操作终端!!!	2025-11-27 20:3...
5	启动操作终端!!!	2025-11-27 19:2...
6	退出操作终端!!!	2025-11-27 18:...


清空

退出

3.9

PLC

PLC

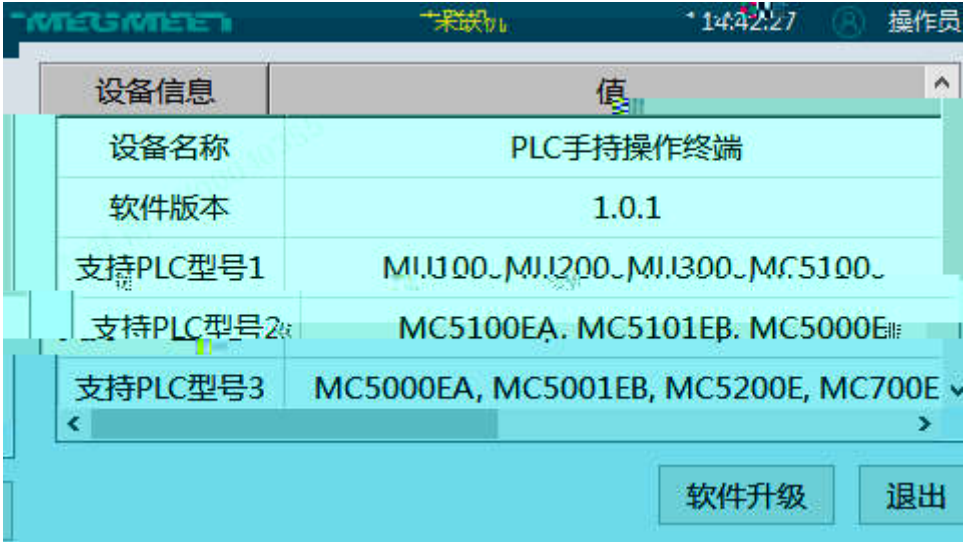


18

, U

(.tar)

3.10

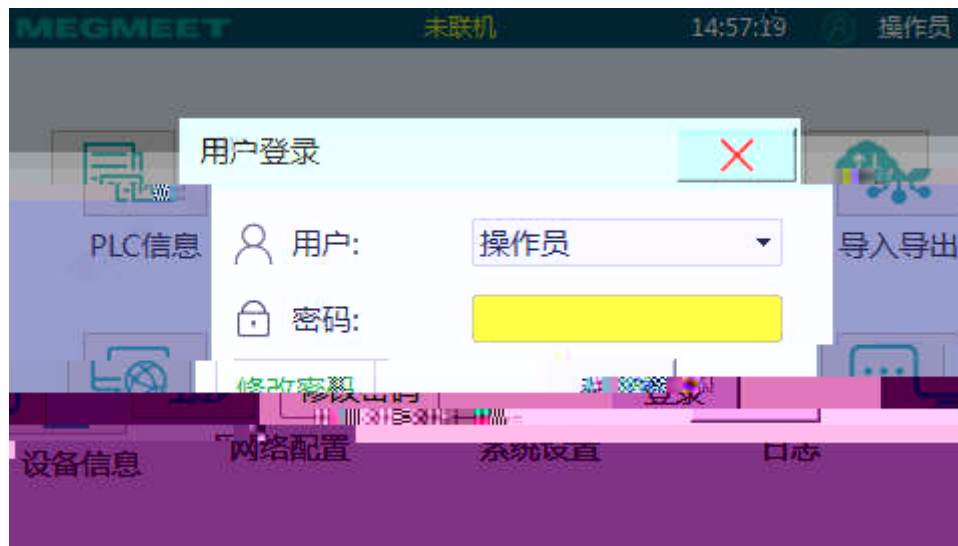

19



20